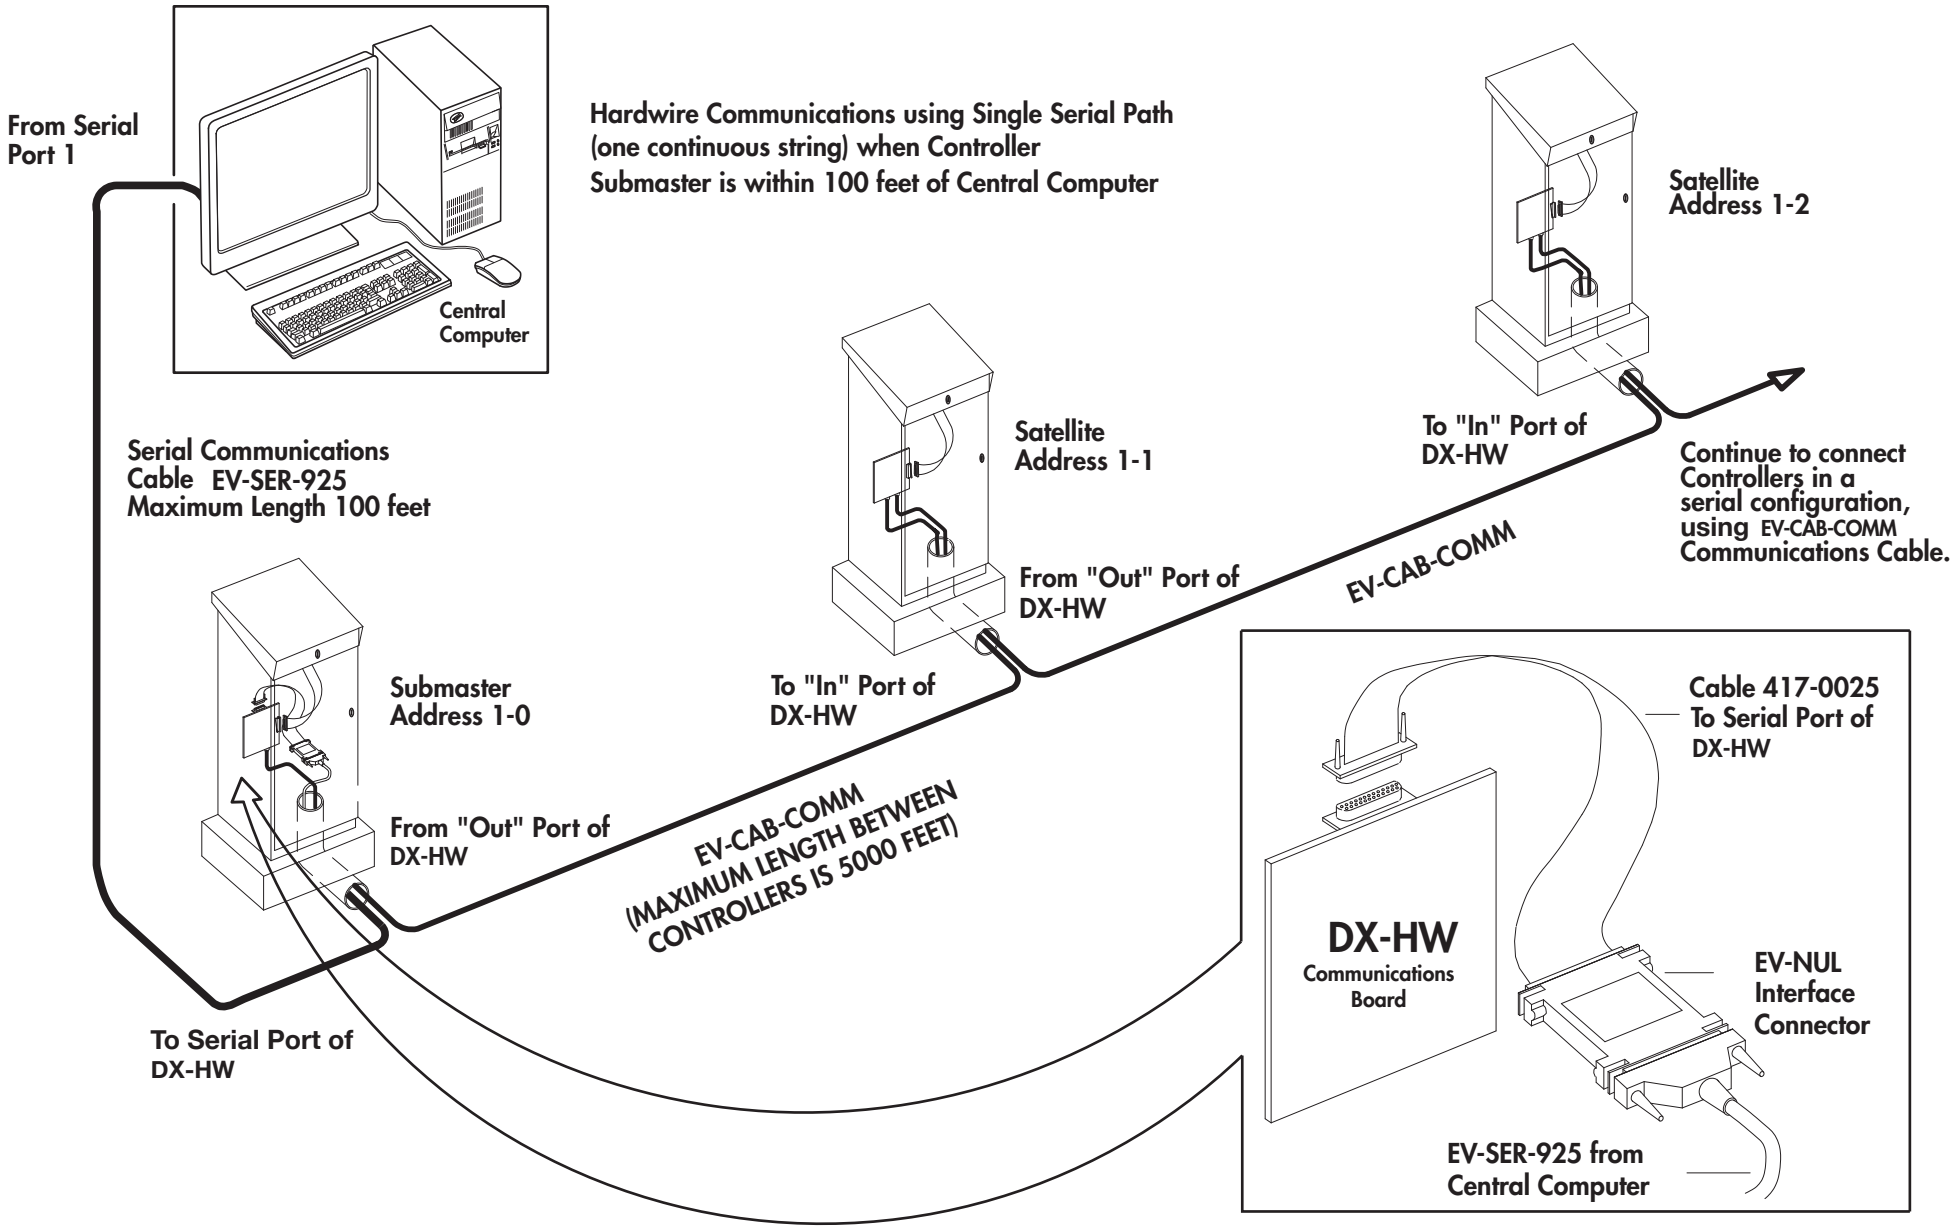
From Serial Port 1
Central Computer
Hardwire Communications using Single Serial Path (one continuous string) when Controller Submaster is within 100 feet of Central Computer
Satellite Address 1-2
Satellite Address 1-1
To "In" Port of DX-HW
Continue to connect Controllers in a serial configuration, using EV-CAB-COMM Communications Cable.
Serial Communications Cable EV-SER-925 Maximum Length 100 feet
From "Out" Port of DX-HW
EV-CAB-COMM
Submaster Address 1-0
To "In" Port of DX-HW
From "Out" Port of DX-HW
EV-CAB-COMM (MAXIMUM LENGTH BETWEEN CONTROLLERS IS 5000 FEET)
Cable 417-0025 To Serial Port of DX-HW
DX-HW
Communications Board
EV-NUL Interface Connector
To Serial Port of DX-HW
EV-SER-925 from Central Computer